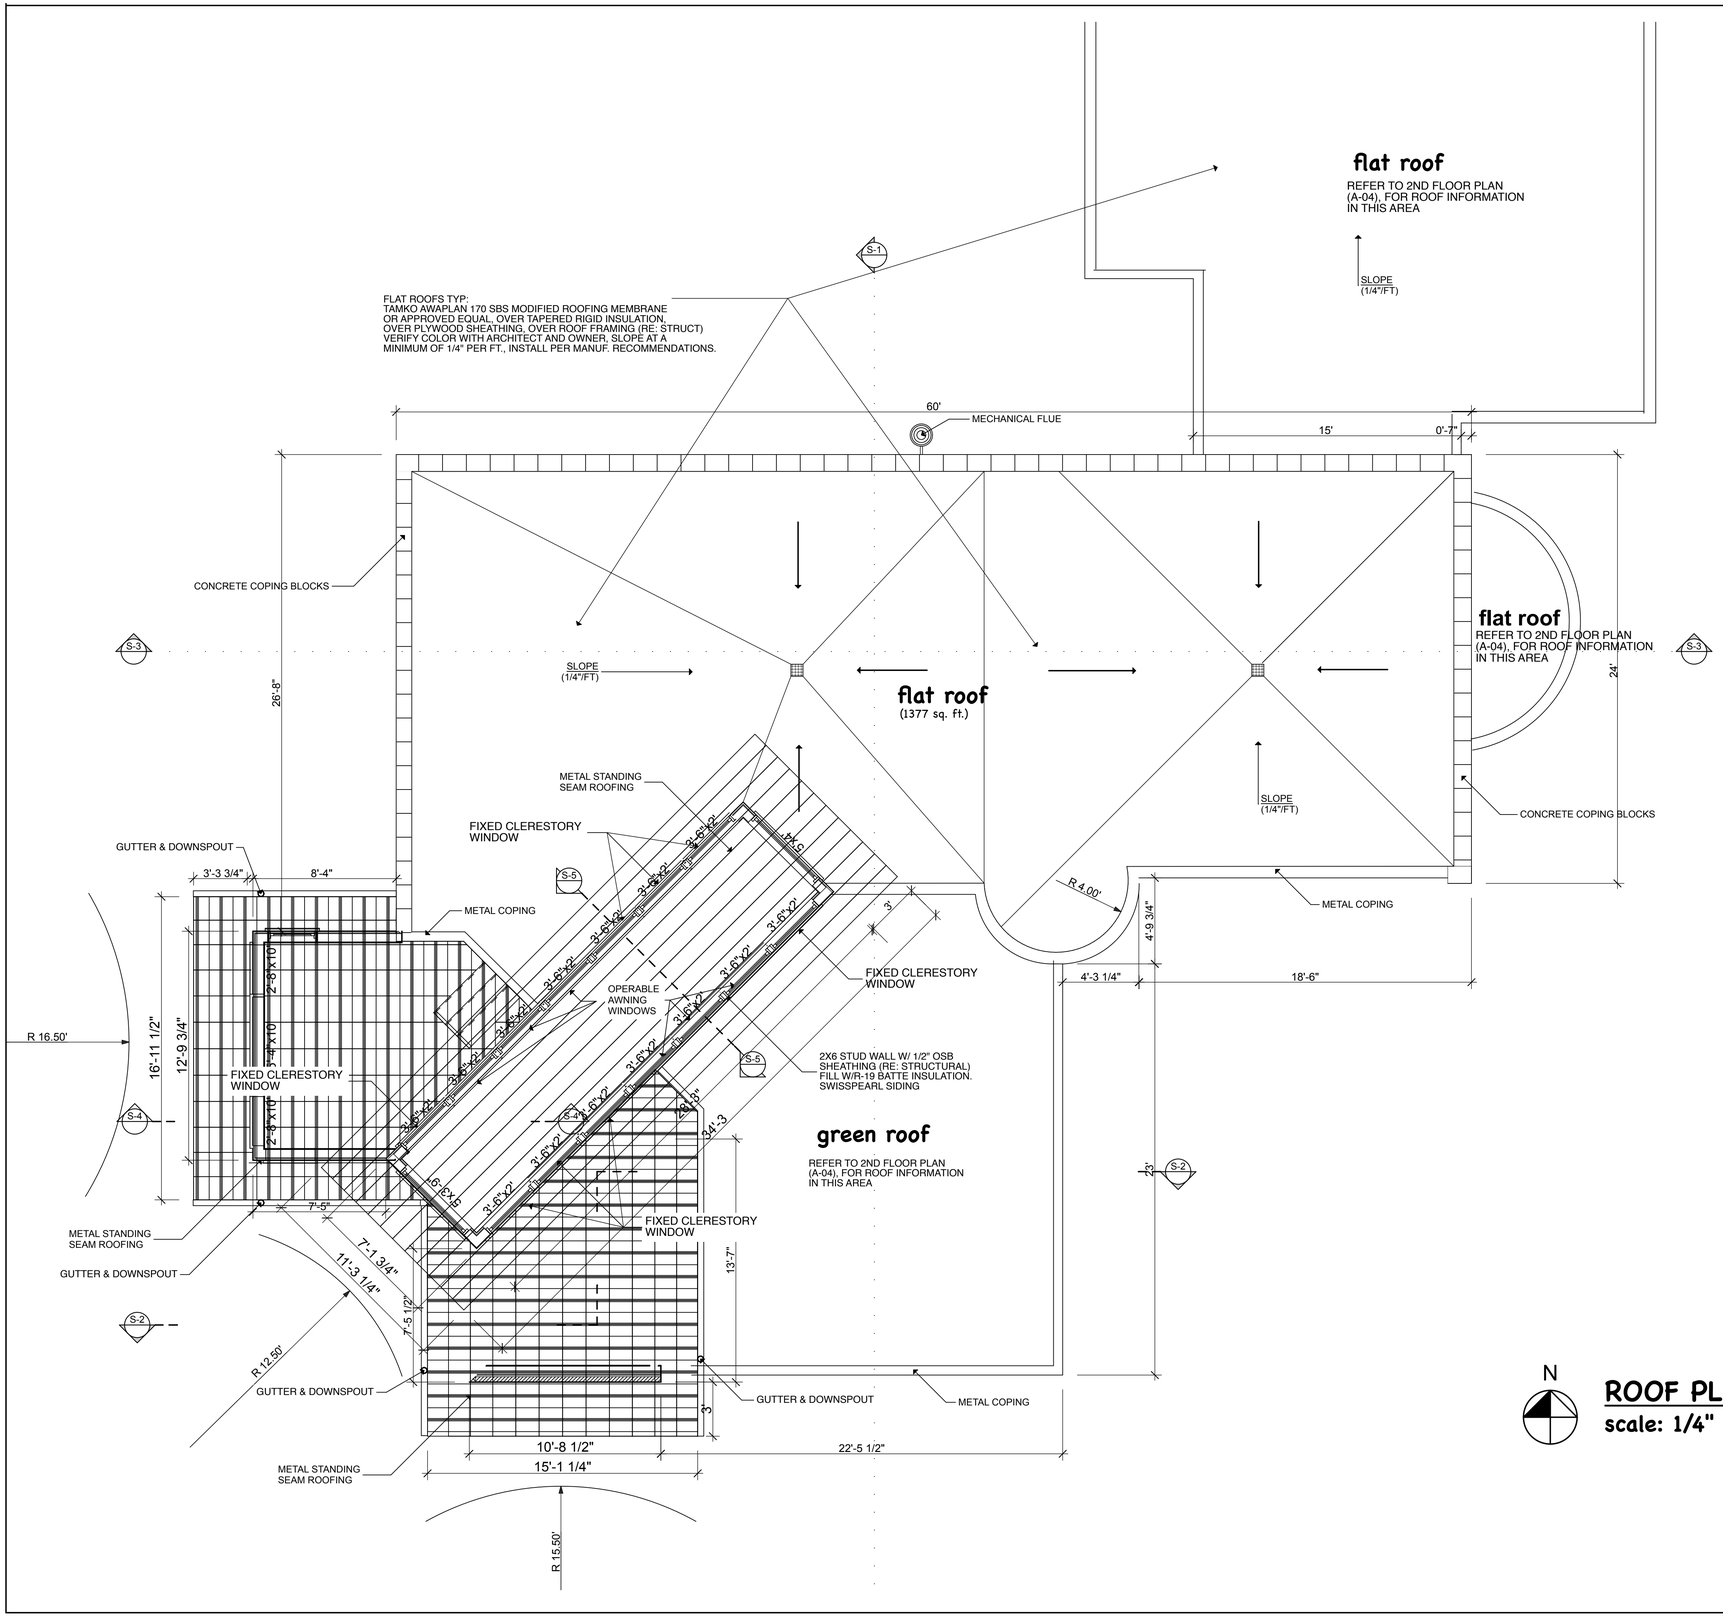

ROOF PLAN NOTES

1 VAULTED ROOFS TO BE METAL STANDING SEAM. INSTALL A PER MANUFACTURER'S RECOMMENDATIONS. VERIFY COLOR WITH OWNER AND ARCHITECT.

2. FLAT ROOF AND DECK TO BE TAN 60 MIL. EPDM ROOF MEMBRANE ON TAPERED RIGID INSULATION. VERIFY COLOR WITH OWNER AND ARCHITECT.

3. PROVIDE FLASHING AS REQUIRED BY ROOFING MANUFACTURER AT ALL ROOF PENETRATIONS. EAVES, INTERSECTIONS, ETC. PAINT OR PRE-FINISH ALL ROOF FLASHING TO MATCH COLOR ORMATERIAL.

4. ROOF PENETRATIONS SUCH AS PLUMBING AND FLUE VENTS SHALL BE DESIGN-BUILD AND ARE TO BE PAINTED TO MATCH THE COLOR OFTHE ROOF.

5. 26 GA. METAL GUTTERS SHALL BE HALF ROUND AND DOWN SPOUTS SHALL BE ROUND, COLOR OR MATERIAL TO BE SELECTED BY ARCHITECT. PROVIDE EXTENDERS AND CONCRETE SPLASH BLOCKS. SEE ROOF PLAN, SECOND FLOOR PLAN AND ELEVATIONS FOR LOCATIONS.

N

ROOF PLAN
scale: 1/4" = 1'-0"

Virginia DuBrucq, AIA
1919 E. Mississippi Ave.
Denver, Colorado 80210
△ 303-698-2200
F 303-698-9397
E ginnydubrucq@qwestoffice.net

ANDERMAN RESIDENCE
830 SOUTH ST. PAUL ST.
DENVER COLORADO 80209

ROOF PLAN

revised:
FOR CONSTRUCTION

date: APRIL 1, 2008

drawing #
A-05